


TCVGH Room Temperature Log

Air Temp (°C)

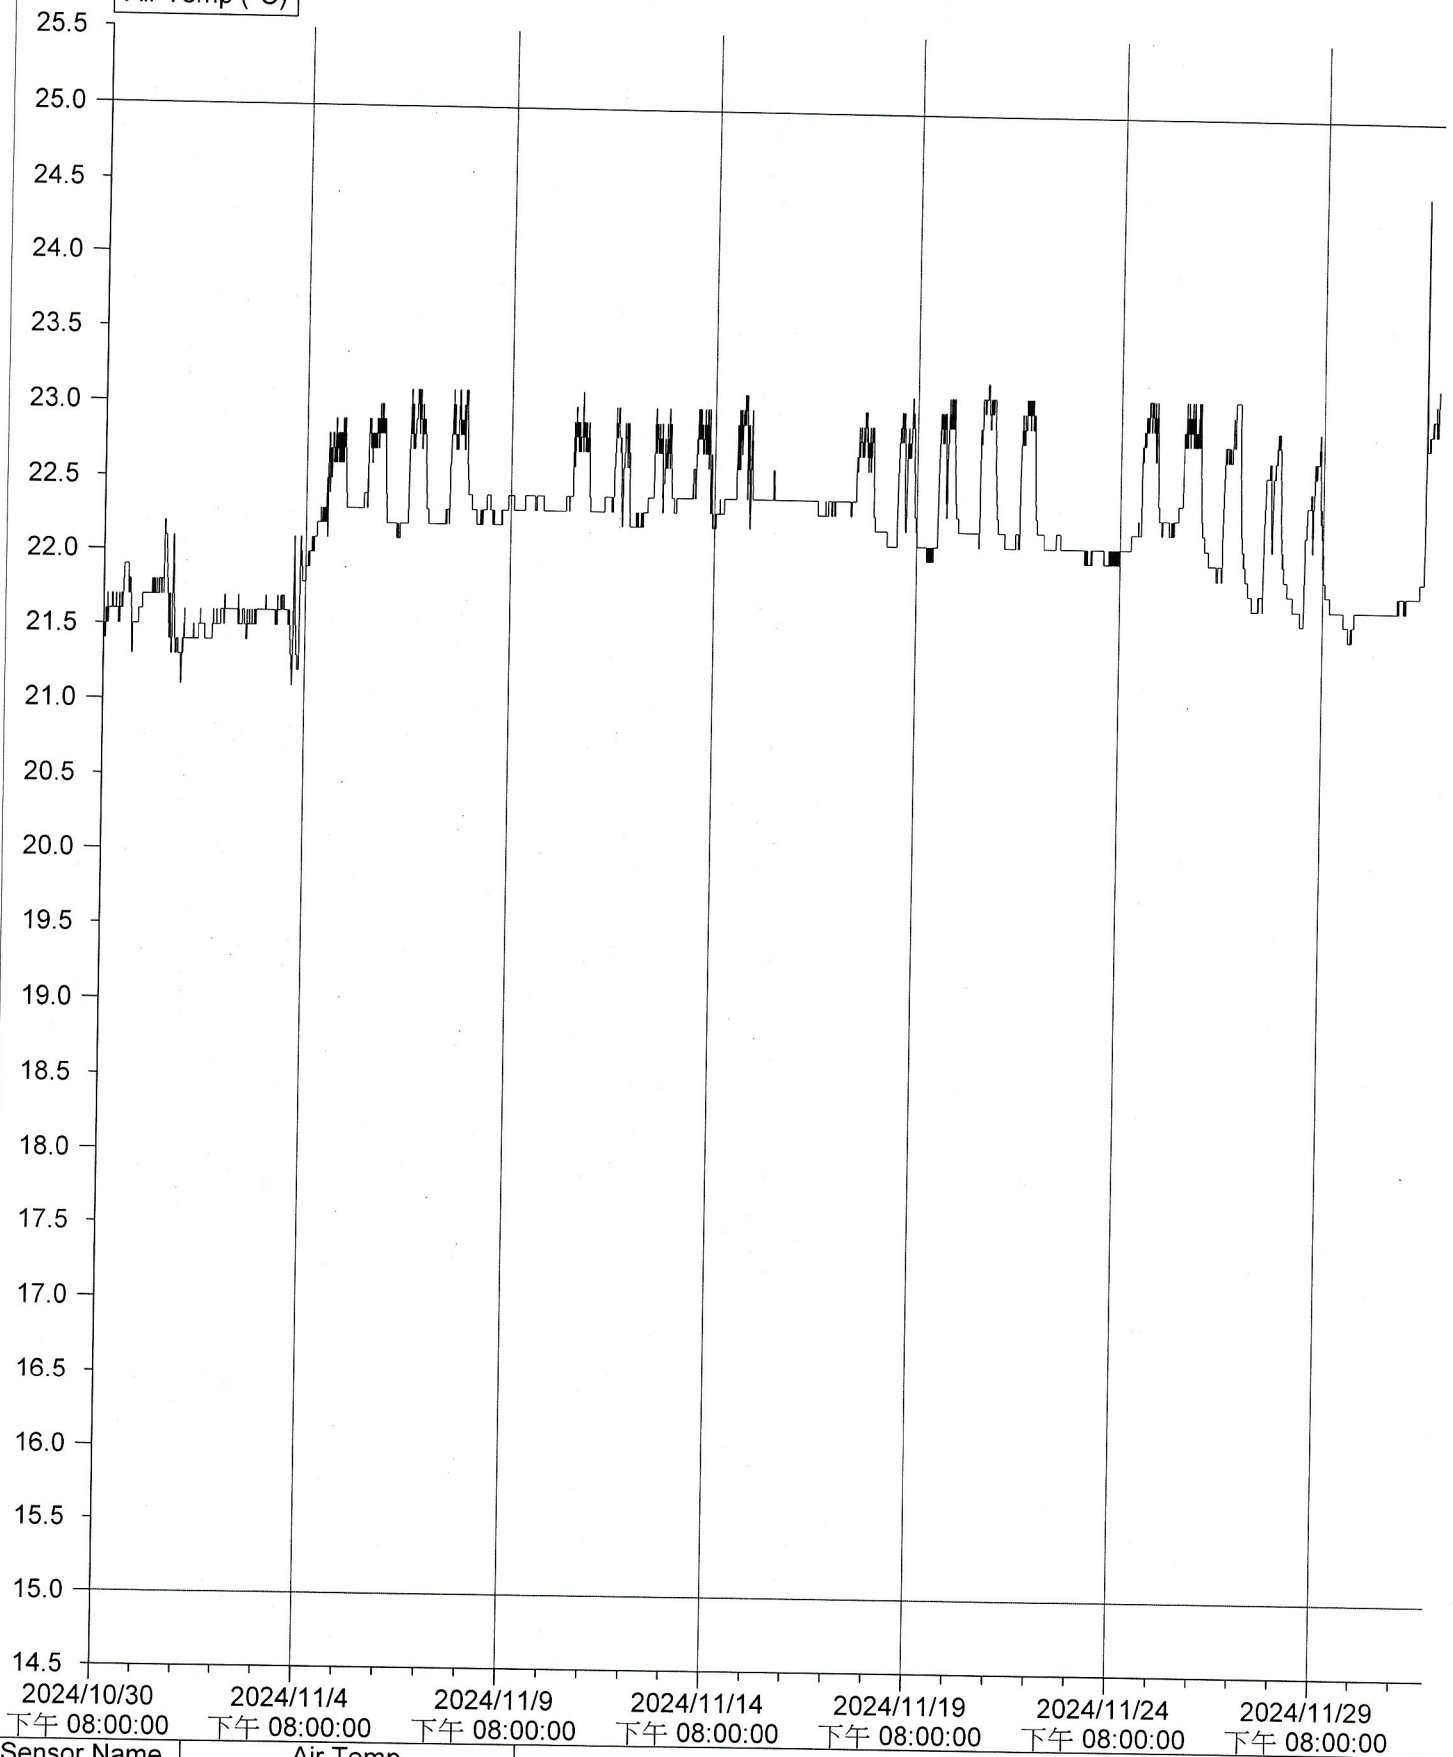

2024/10/30 下午 08:00:00 2024/11/4 下午 08:00:00 2024/11/9 下午 08:00:00 2024/11/14 下午 08:00:00 2024/11/19 下午 08:00:00 2024/11/24 下午 08:00:00 2024/11/29 下午 08:00:00

Sensor Name	Air Temp
Legend	
Description	Room Temperature 3
Serial Number	2106-0085
Product Code	EI-HS-D-32-L
Start	2024/10/30 下午 08:00:00
Finish	2024/12/2 下午 04:00:00
Sensor Range	-40.5 to 70.4 °C
Specification	15.0 to 25.0 °C
Average	22.2 °C
Highest	24.5 °C
Lowest	21.1 °C

university
03 Dec 2024